



Pre No. CC241469-01-R2

# SPECIAL SEISMIC CERTIFICATION CERTIFICATE OF COMPLIANCE

## Equipment Manufacturer


**Manufacturer:** HIPOWER  
**Model Line:** HDI60F-350F & HDI400-600V  
**Product Type:** Generators  
**Address:** 16600 South Theden St.  
Olathe, Kansas 66062  
**Phone:** (913) 293-7723  
**Website:** www.hipowersystems.com

## Certification Agency

**Issue Date:** 10-Jan-2025 (revised 29-Jan-2025)  
**Expiration Date:** 10-Jan-2031  
**Agency Name:** Pre Compliance  
**Address:** 36 SW Wall Street  
Bend, OR 97702  
**Phone:** (541) 241-2310  
**Website:** www.go-pre.com

## Seismic Certification Parameters

**Method of Certification:** Shake Table Testing  
**Assessment Standard:** ICC-ES AC156  
**Mounting Configuration:** Base Mounted - Rigid/Isolated  
**Building Codes:** IBC 2021, 2024  
**Importance Factor ( $I_p$ ):** 1.5  
 **$S_{DS}$  for  $z/h = 1$ :** 2.00 g  
 **$S_{DS}$  for  $z/h = 0$ :** 2.50 g  
 **$A_{flx-h}$ :** 3.20 g       **$A_{flx-v}$ :** 1.68 g  
 **$A_{rig-h}$ :** 2.40 g       **$A_{rig-v}$ :** 0.68 g

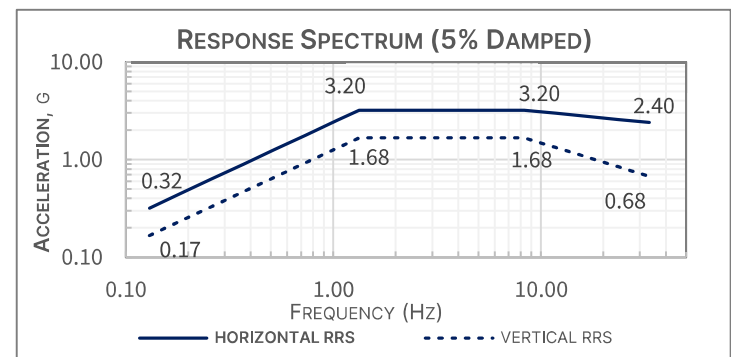

## Certification Terms

- For specific models covered under this certification, see Table of Certified Components and Subcomponents accompanying this certificate.
- For products with  $I_p \geq 1.0$ , the product is expected to retain position following the design earthquake and is not expected to pose a threat to life and limb.
- For components with  $I_p = 1.5$  and certified by testing, the component is expected to remain operational following the design earthquake. Limited structural yielding is expected and minor repairs may be required.
- This certification is dependent on proper mounting and anchorage in the listed mounting configuration(s). This certification does not specify anchorage design due to the variability of supporting structure and substrate conditions that may be present at the installation location.
- Certified products are approved for the Building Codes listed and previous editions of those codes. Extension of this certificate to other Building Codes requires assessment of parameters by Pre Compliance. The seismic levels listed are valid for all soil types and seismic design categories.

## Approval

I attest that I have impartially reviewed the documentation supporting this special seismic certification and have confirmed it is in general conformance with the referenced codes and standards and that it meets the seismic levels required for the listed site.

**Name:** Andy Coughlin, SE  
**Title:** Principal Engineer  
**Email:** andy@go-pre.com  
**Phone:** (415) 635-8461  
**License:** S6082 (California)

**Signature:**

Andrew M Coughlin

Digitally signed by Andrew M Coughlin  
Reason: This item has been digitally signed and sealed by  
Andrew M. Coughlin on the date below. Printed copies of this  
document are not considered signed and sealed and the  
signature must be verified on any electronic copies.  
Contact Info: andy@go-pre.com  
Date: 2025.01.29 10:59:45-08'00'

