



Pre No. CC251710-02-R0

# WIND CERTIFICATION CERTIFICATE OF COMPLIANCE

## Equipment Manufacturer

**Manufacturer:** Guntner de Mexico, S.A. DE C.V.  
**Model Line:** ADCHD - Air Cooler  
**Product Type:** Chillers – Air Cooled  
**Address:** Rogelio Gonzalez Caballero #1000  
Parque Ind. Stiva Aeropuerto  
66626 Apodaca, N.L. Mexico  
**Phone:** +1 (224) 407-6376  
**Website:** www.guntner.com

## Certification Agency

**Issue Date:** 11-Sep-2025  
**Expiration Date:** 11-Sep-2031  
**Agency Name:** Pre Compliance  
**Address:** 324 NW Hill Street  
Bend, OR 97703  
**Phone:** (541) 241-2310  
**Website:** www.go-pre.com

## Wind Certification Parameters

**Building Code(s):** IBC 2021

**Mounting Configuration:** Base Mounted - Rigid


**Risk Categories:** I, II, III, IV

**Exposure(s):** B, C, D

**Method of Certification:** ASCE 7-16 Equivalent  
Static Analysis

$V_{ULT} \leq 202$  mph Basic Wind Speed, Exposure B<sup>1</sup>  
 $V_{ULT} \leq 165$  mph Basic Wind Speed, Exposure C<sup>1</sup>  
 $V_{ULT} \leq 150$  mph Basic Wind Speed, Exposure D<sup>1</sup>  
 $F_h/A_f = 65.0$  psf Horizontal Basis Pressure  
 $F_v/A_f = 45.0$  psf Vertical Basis Pressure

<sup>1</sup>Based on ASCE 7-16 Sec. 29.4.1 and the following parameters:  
Height  $\leq 15$ -ft; Topography Factor,  $K_{ZT} = 1.0$ ; Wind Directionality Factor,  
 $K_d = 0.85$ ; Ground Elevation Factor,  $K_e = 1.0$ ; Horizontal Gust Effect and  
Pressure Product,  $GC_r = 1.0$ ; and Vertical Gust Effect and Pressure  
Product,  $GC_r = 1.0$ . Adjust for other conditions.

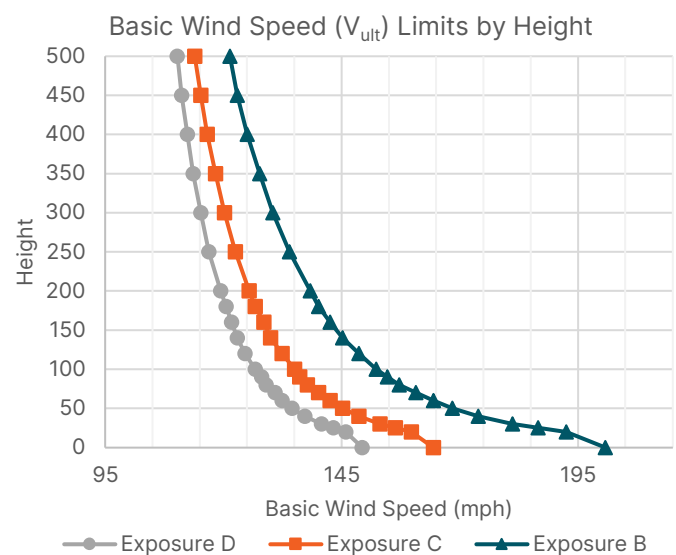

## Certification Terms

- For specific models covered under this certification, see Table of Certified Components and Subcomponents accompanying this certificate.
- This certification is dependent on proper mounting and anchorage in the listed mounting configuration(s). This certification does not specify anchorage design due to the variability of supporting structure and substrate conditions that may be present at the installation location.
- Certified products are approved for the Building Codes listed and previous editions of those codes. Extension of this certificate to other Building Codes requires assessment of parameters by Pre Compliance.

## Approval

I attest that I have impartially reviewed the documentation supporting this wind certification and have confirmed it is in general conformance with the referenced codes and standards.

**Signature:**

**Name:** Andy Coughlin, SE  
**Title:** Principal Engineer  
**Email:** andy@go-pre.com  
**Phone:** (415) 635-8461  
**License:** S6082 (California)

