



Pre No. CC251851-01-R0

SPECIAL SEISMIC CERTIFICATION CERTIFICATE OF COMPLIANCE

Equipment Manufacturer


Manufacturer: Nortek Air Colutions, LLC
Model Line: Venmar Custom Air Handling Units
Product Type: Air Handling Units – Custom
Address: 200 Rue Carter, Saint-Leondard - d'Aston
QC JOC 1M0, Canada
Phone: (873)886-8050
Website: www.nortekair.com

Certification Agency

Issue Date: 29-Mar-2026
Expiration Date: 29-Mar-2032
Agency Name: Pre Compliance
Address: 324 NW Hill Street
Bend, OR 97703
Phone: (541) 241-2310
Website: www.go-pre.com

Seismic Certification Parameters

Method of Certification: Shake Table Testing
Assessment Standard: ICC-ES AC156
Mounting Configuration: Base Mounted - Rigid
Building Codes: IBC 2024
Importance Factor (I_p): 1.5
 S_{DS} for $R_\mu = 1.3$, $H_f = 3.5$ 1.93 g
 S_{DS} for $R_\mu = 1.0$, $H_f = 1.0$ 1.93 g
 A_{flx-h} : 3.08 g **A_{flx-v} :** 1.29 g
 A_{rig-h} : 2.07 g **A_{rig-v} :** 0.52 g

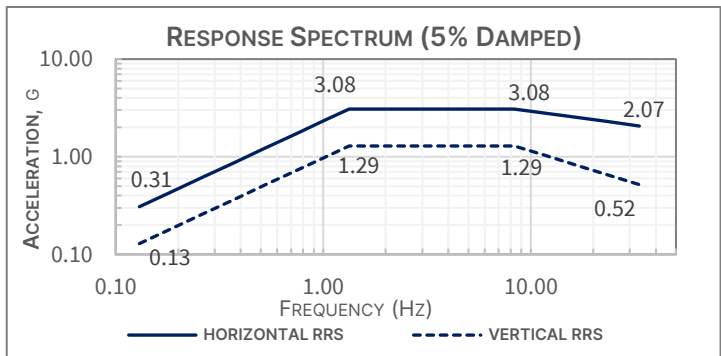

Certification Terms

- For specific models covered under this certification, see Table of Certified Components and Subcomponents accompanying this certificate.
- For products with $I_p \geq 1.0$, the product is expected to retain position following the design earthquake and is not expected to pose a threat to life and limb.
- For components with $I_p = 1.5$ and certified by testing, the component is expected to remain operational following the design earthquake. Limited structural yielding is expected and minor repairs may be required.
- This certification is dependent on proper mounting and anchorage in the listed mounting configuration(s). This certification does not specify anchorage design due to the variability of supporting structure and substrate conditions that may be present at the installation location.
- Certified products are approved for the Building Codes listed and previous editions of those codes. Extension of this certificate to other Building Codes requires assessment of parameters by Pre Compliance. The seismic levels listed are valid for all soil types and seismic design categories.
- All UUT's were tested in Temtrol ITF or WF constuction. See 2001143-ER-001 for analysis of Venmar vs. Temtrol showing
- Heatwheels added to Table 9 via certification by analysis. See 2100393-ER-001 for analysis of added subcomponents.

Approval

I attest that I have impartially reviewed the documentation supporting this special seismic certification and have confirmed it is in general conformance with the referenced codes and standards.

Signature:

Name: Andy Coughlin, SE
Title: Principal Engineer
Email: andy@go-pre.com
Phone: (415) 635-8461
License: S6082 (California)

